


DUCT STUB DETAIL

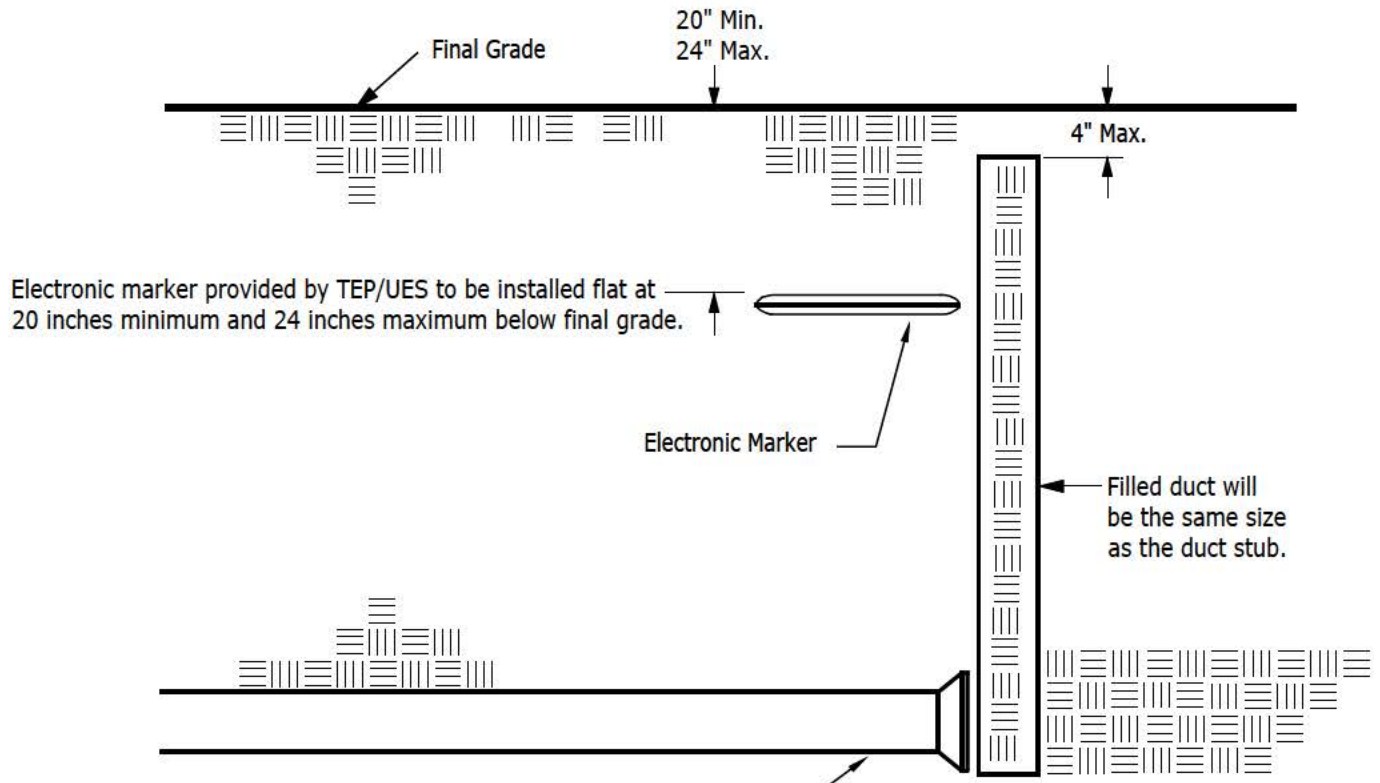

Electronic marker provided by TEP/UES to be installed flat at 20 inches minimum and 24 inches maximum below final grade.

Electronic Marker

Filled duct will be the same size as the duct stub.

Size and number of ducts as indicated on TEP/UES drawing. Plug open ends with duct plugs.

Inspection to be scheduled (TEP 918-8300 / UES 761-7951) to verify the Electronic Marker and Filled Duct installation

		INITIATED BY	SC	REVISION NO.	4	SR-218 Pg. 1 of 1
		ESR COMM.	10-91	ESR COMM.	1-17	
				EFFECTIVE DATE	1-17	