



SERVICE ENTRANCE CLEARANCE FROM GAS METER REGULATOR OR EXTENSION VENT



ELECTRIC SERVICE ENTRANCE

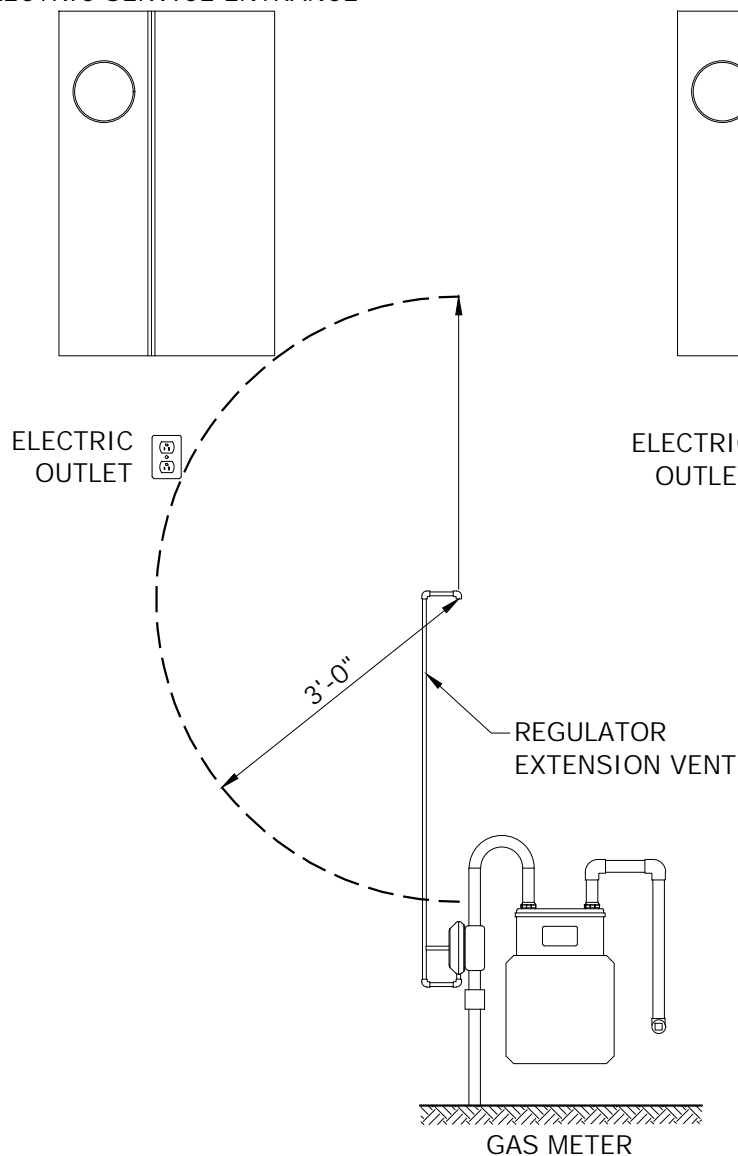

ELECTRIC SERVICE ENTRANCE

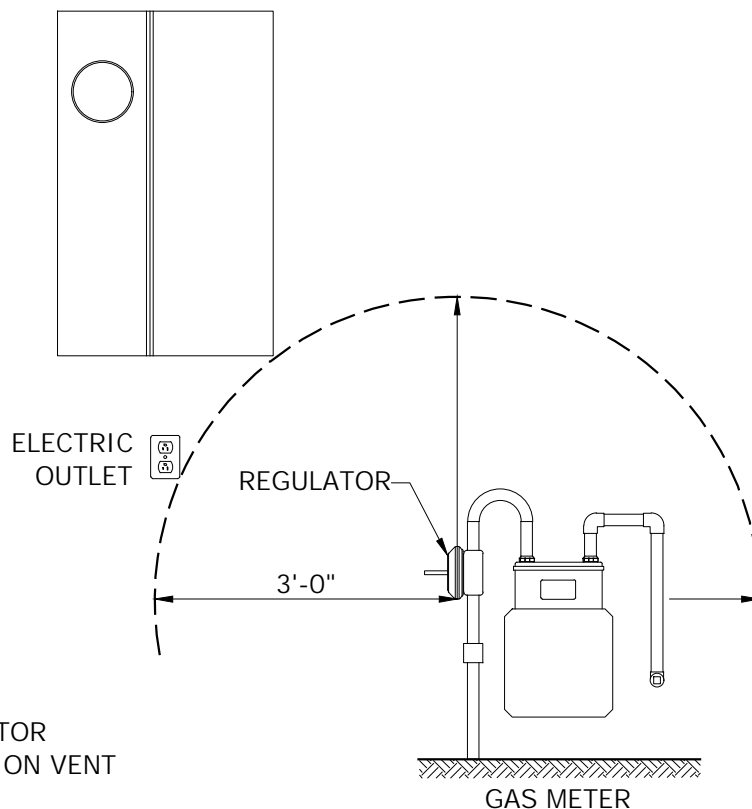

NOTES:

1. INFORMATION IN THIS STANDARD IS PROVIDED TO PROMOTE AWARENESS OF LOCAL GAS COMPANY CLEARANCE REQUIREMENTS.
2. A NEW ELECTRIC SERVICE ENTRANCE SHALL BE INSTALLED TO PROVIDE A MINIMUM OF 3 FEET CLEARANCE TO GAS METER REGULATOR OR REGULATOR EXTENSION VENT. IF SERVICE ENTRANCE IS BEING RELOCATED CUSTOMER SHOULD CONTACT THE LOCAL GAS COMPANY FOR JOB SPECIFIC CLEARANCE REQUIREMENTS.